



Suggested layout proposal!

System 1.TX700

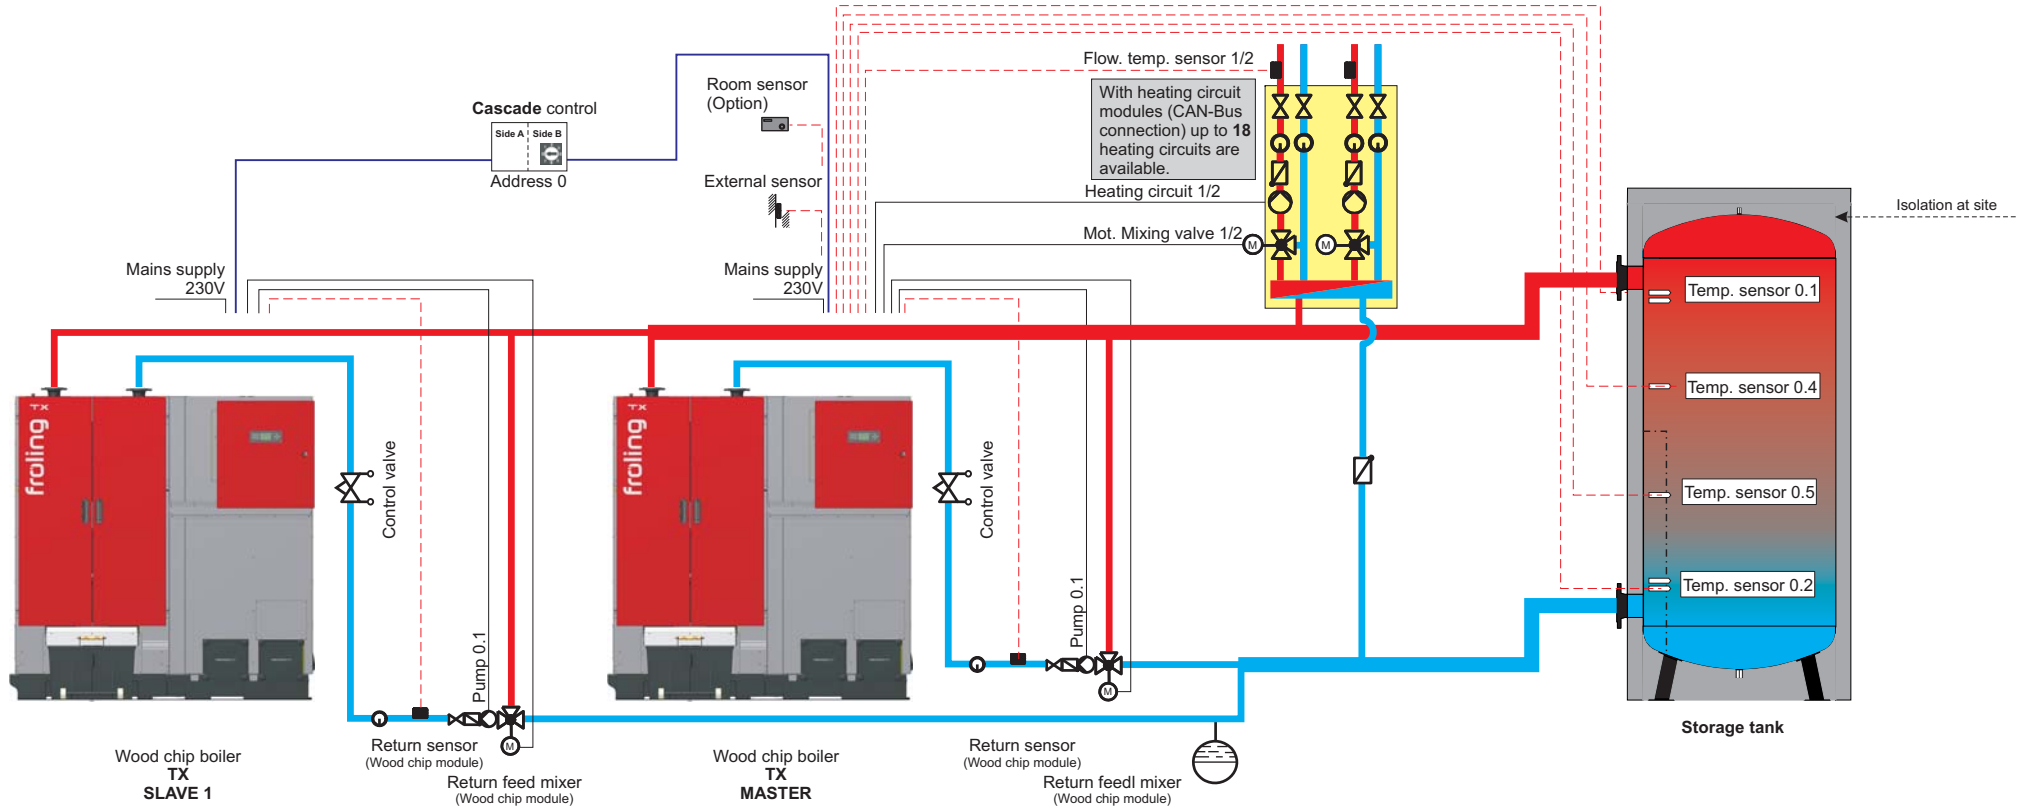

Note: At all boilers set the parameter BOILER STOPS AUTOMATICALLY WHEN NO HEAT REQUIRED to "YES".
 From version V50.04 B05.01. Controller H3200 TX
DO NOT USE ELECTRONICALLY CONTROLLED PUMPS FOR THE STORAGE TANK!!
 DUE TO LEGAL REQUIREMENTS SEVERAL CHIMNEYS ARE NECESSARY!

		Name	Date	Remarks
	Signed	Krl	20.12.10	
	Checked by	Dpl	20.12.10	