



Suggested layout proposal!

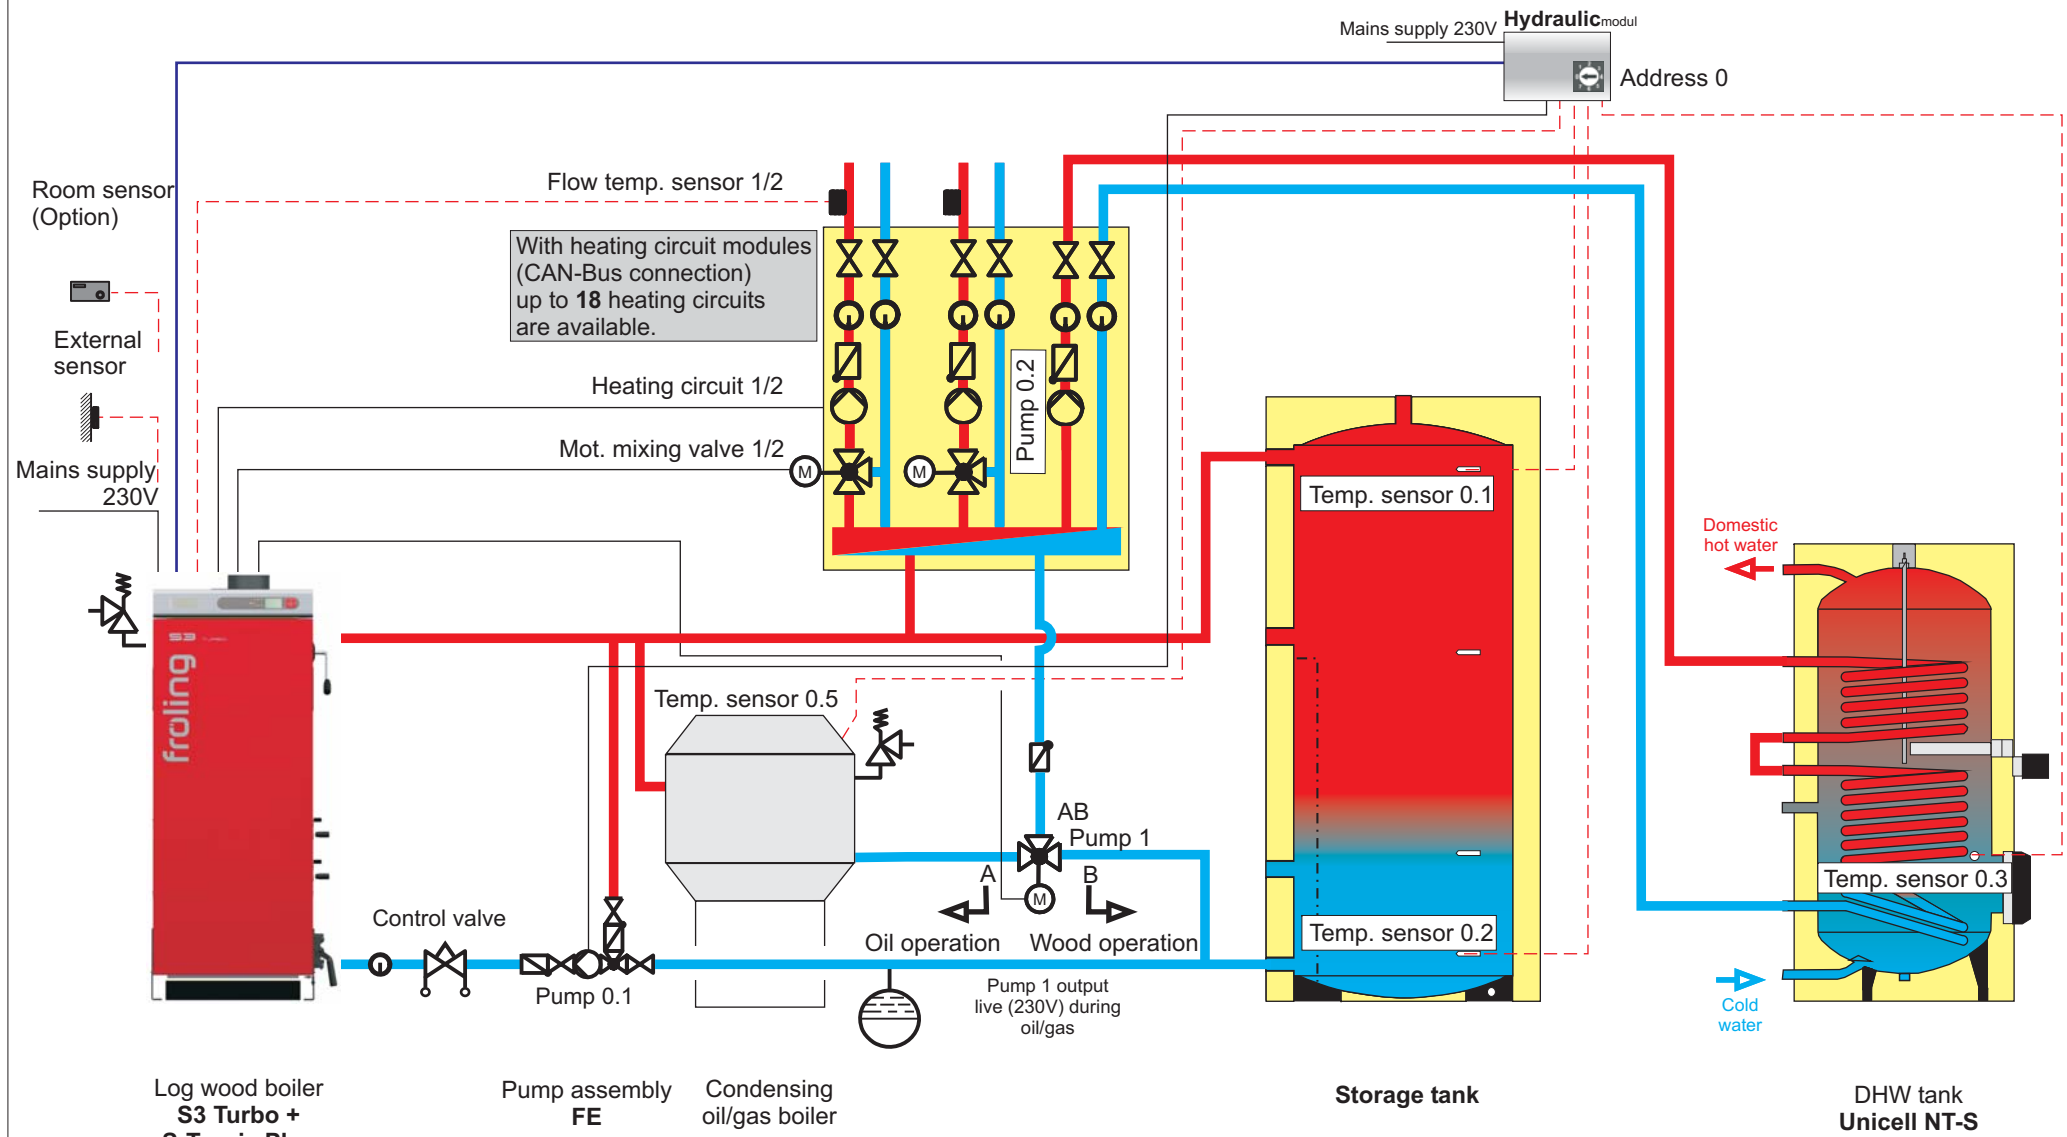

Log wood boiler S3 Turbo + S-Tronic Plus Pump assembly FE Condensing oil/gas boiler Storage tank DHW tank Unicell NT-S

Note: Please set parameter in menu STORAGE TANK, item SERVICE, WHICH PUMP IS USED FOR THE STORAGE TANK to "0.1".
 Set parameter in menu BOILER 2, item SERVICE, WHICH OUTPUT IS USED FOR UNLOADING FOLLOW-UP BOILER to "Pump 1!"
 Controller S3200

		Name	Date	Remarks
	Signed	Krl	10.09.10	
	Checked by	Dpl	10.09.10	